


Conference Room

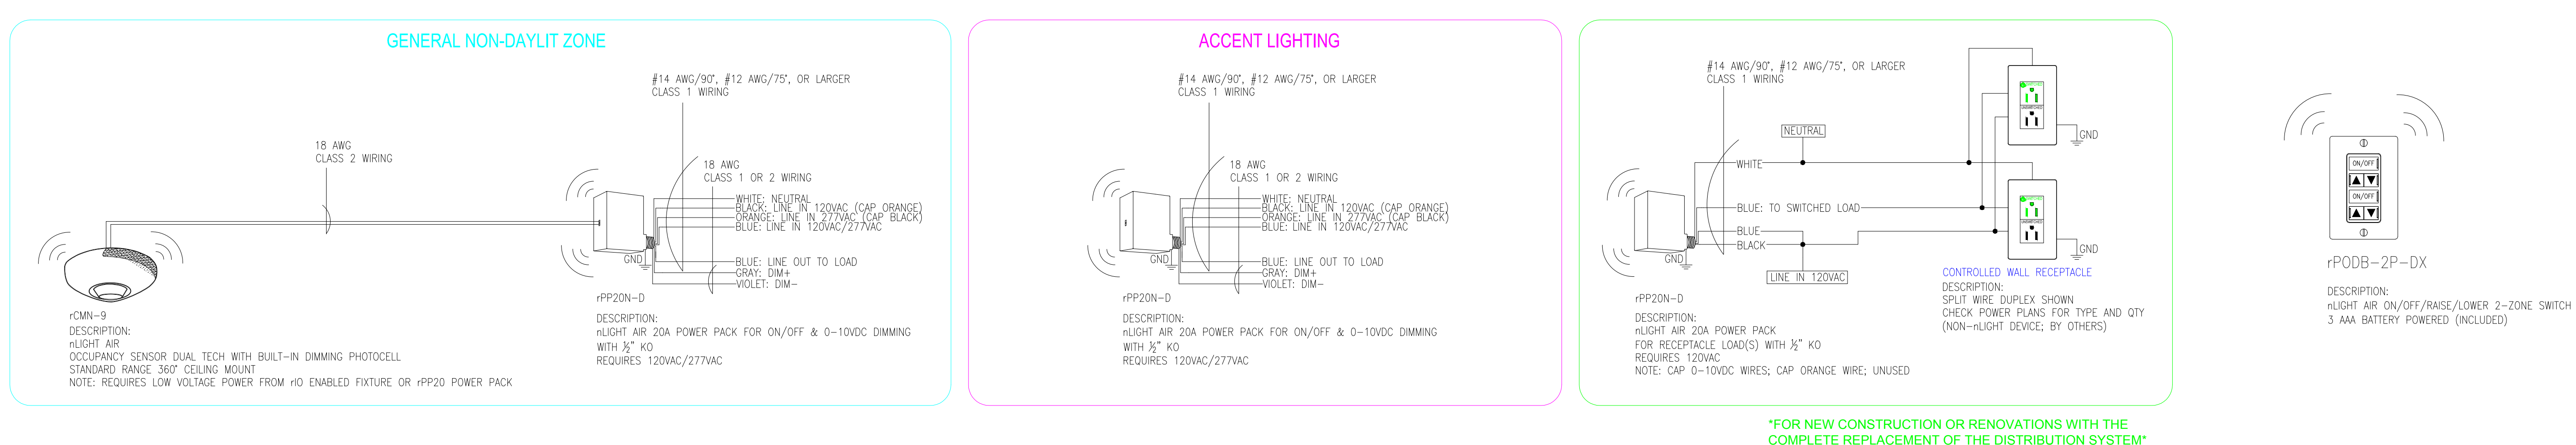

NTS

TYPICAL CONFERENCE ROOM USING nLIGHT POWER PACKS

REFER TO PLANS FOR TYPES AND QUANTITIES

T24 2016 COMPLIANT SEQUENCE OF OPERATION:

1. OCCUPANCY SENSOR PROVIDES PARTIAL ON TO 70% AND AUTOMATIC OFF OF LIGHTS AND CONTROLLED RECEPTACLES BASED ON ROOM OCCUPANCY (USE 10 MINUTE DEFAULT TIME DELAY FOR OCCUPANCY SENSOR) .
2. DUAL ZONE PHOTOCELL SHALL AUTOMATICALLY REDUCE GENERAL LIGHTING IN BOTH PRIMARY AND SECONDARY DAYLIT ZONES BASED ON DAYLIGHT TO MAINTAIN DESIGN ILLUMINANCE.
3. rPODB DX SWITCH PROVIDES MANUAL OVERRIDE OF THE LIGHTS: ON/OFF/RAISE/LOWER.

REV	DATE

Date: _____

Scale: NOT TO SCALE

Drawn By: _____

Project #: _____

DWG Ref: _____

Sheet: _____